

Avoiding Component Failure in Industrial Refrigeration Systems

By Tim Kroeger, segment marketing manager industrial refrigeration, Asia Pacific & India

The article categorises and gives examples of typical component failures in industrial refrigeration systems. It lists the root causes and describes how to avoid them. Focus is on liquid hammer, safe hot gas defrost and general refrigeration piping.

Optimum

results by correct
selection,
integration and
operation

1. Liquid hammer

1.1 Definition

Liquid hammer is a term used to describe a pressure spike caused when a fluid in motion is forced to stop or change direction suddenly (momentum change)¹. Liquid hammer can occur when a valve closes suddenly at the end of a pipeline system, and a pressure wave propagates in the pipe. Liquid Hammer can also occur when liquid is suddenly accelerated and then forced to change momentum. Liquid hammer is also called hydraulic shock.

Examples of liquid hammer include the following:

- **Sudden deceleration.** High impact forces can occur when a valve is closed quickly.
- **Sudden acceleration.** Most commonly encountered during hot gas defrost initiation and termination. Also referred to as Vapour Propelled Liquid Slug (VPLS).
- **CIS (Condensation-Induced Hydraulic Shock).** Sudden condensation of vapour bubbles in highly sub-cooled (>20K) liquid. Not covered in this article.

1.2 Sudden deceleration

An estimation of the pressure spike occurring during the sudden deceleration of a liquid in motion can be attempted by visualising a moving column or slug of liquid in a pipe ahead of a valve or an armature, see figure 1.

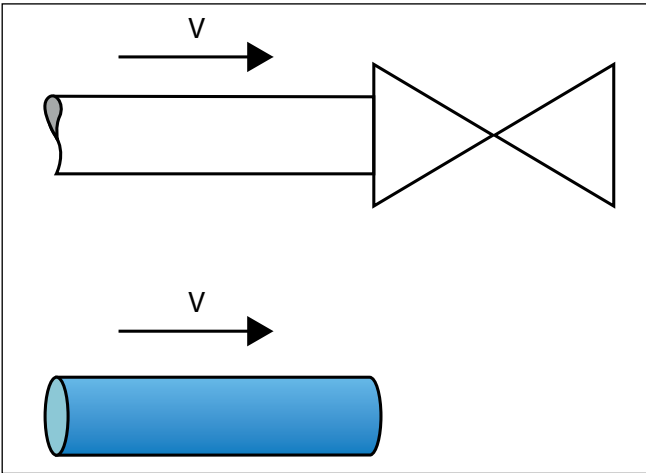


Figure 1: Moving liquid in pipe

When this slug of liquid is suddenly stopped, a force builds up against the cross section of the valve or armature which equals the force resulting from the rate of change of momentum.

The force generated by the deceleration can be calculated as

$$F = p \times A = m \times a = \frac{m \times \Delta v}{t}$$

with:

p	pressure	[Pa]
A	cross section	[m ²]
m	mass	[kg]
a	acceleration	[m/s ²]
Δv	velocity change	[m/s]
t	time of deceleration	[s]

or:

$$F = p \times A = m \times a = \frac{L \times A \times \rho \times \Delta v}{t} \quad \div A$$

$$p = \frac{L \times \rho \times \Delta v}{t}$$

with:

L	length of pipe	[m]
ρ	cross section	[kg/m ³]

Example

A solenoid valve is installed in a 20 metre straight run in a slightly undersized liquid line (velocity 3 ms⁻¹). Refrigerant is ammonia (density 600 kg/m³). The closing time of the solenoid valve is estimated at 20 ms.

Estimation of pressure surge

$$p = \frac{L \times \rho \times v}{t} = \frac{20 \text{ m} \times 600 \text{ kgm}^{-3} \times 3 \text{ ms}^{-1}}{0.02 \text{ s}}$$

$$p = 1,800,000 \frac{\text{m kgm}^{-3} \text{ ms}^{-1}}{\text{s}} = 1.8 \times 10^6 \frac{\text{kgm m}}{\text{s}^2 \text{ m}^2} = 1.8 \times 10^5 \text{ Pa} = 18 \text{ bar}$$

This is an over pressure, i.e. above the already existing liquid pressure of the system (most commonly the condensing pressure). This could easily result in exceeding the maximum safe operating pressure of componentry.

Hydraulic shock caused by deceleration can be observed by banging or knocking of the valve and over time can lead to stress fractures.

¹) Wikipedia, definition of fluid hammer.

Recommendations

If the solenoid valve is installed in a HP liquid line (e.g. feed line into a LP vessel) and is not pilot operated, the closing time will be rather short, due to the high pressure differential across the valve.

Therefore, one should consider a proportional liquid level control with a motorised valve, see figure 2.

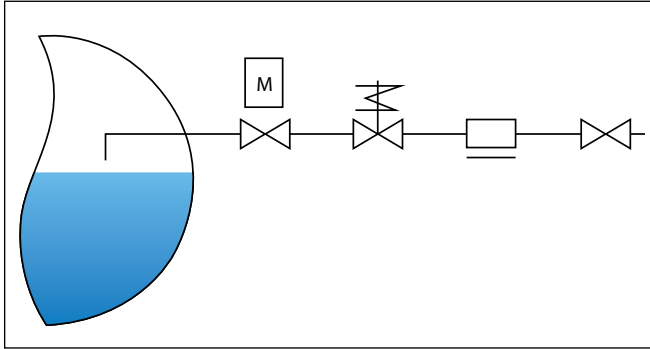


Figure 2: Motorised valve for liquid level control

Excessive pipe runs between solenoid valve and metering device (hand regulating valve) should be avoided for overfeed evaporators. When the solenoid valve is activated, the sudden inrush of liquid can cause hammering at the hand regulating valve, see figure 3.

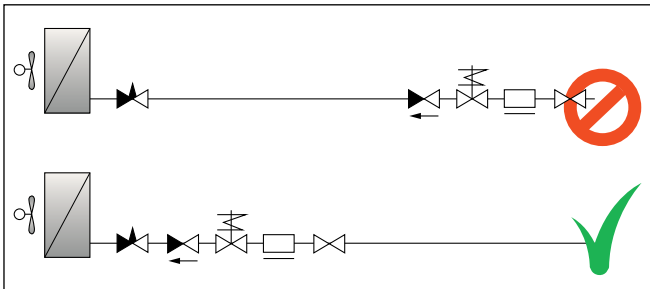


Figure 3: Avoid excessive pipe runs

It should also be ensured that all liquid line valve stations are sized correctly by taking into consideration the overfeed ratio. An oversized liquid feed valve can lead to excessive liquid velocity. During commissioning, care must be taken that all regulating valves are adjusted correctly. A wide open regulating valve can also cause excessive velocity, see figure 4.

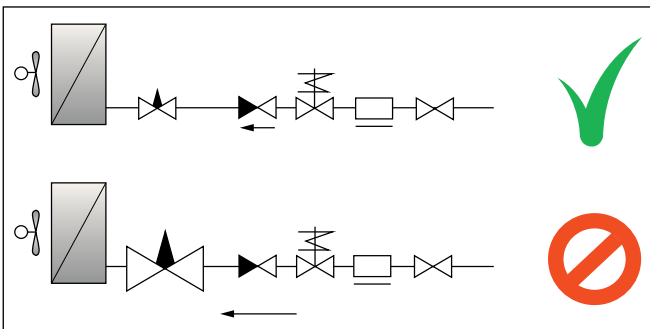


Figure 4: Effect of oversized liquid feed valves

1.3 Sudden acceleration

Accelerated liquid often occurs when high pressure vapour meets low to medium pressure liquid. When the accelerated liquid meets an obstruction, which in turn results in a change of momentum, pressure spikes much higher than those caused by decelerated liquid occur.

This is called Vapour Propelled Liquid Slugging (VPLS). VPLS can be classified into two forms of liquid slugs: static and dynamic².

A static slug is liquid trapped in a portion of the piping, completely filling it. A dynamic slug is a front of liquid, propelled by vapour. In a 6" pipe, as little as 1 1/2" of liquid can lead to a dynamic slug, see figure 5.

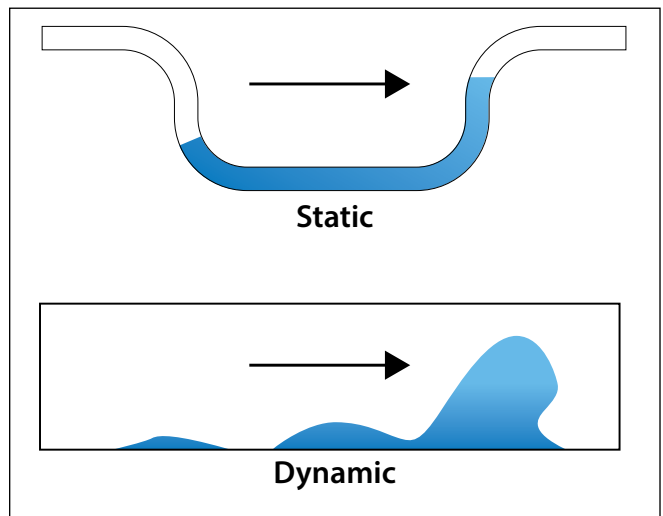


Figure 5: Static and dynamic liquid slugging

2. Hot gas defrost and VPLS

The root cause of VPLS is often an incorrectly designed and operated hot gas defrost system. For example, if the hot gas defrost pressure is controlled by a multi-purpose valve in the wet return line, and the hot gas is therefore injected into the bottom of the evaporator coil, there will be a high risk of accelerated liquid.

Also, if a single step solenoid valve is used in the wet return line, there will be a sudden pressure equalisation after defrost termination. This can also lead to accelerated liquid. As the velocities are much higher than in the previous example

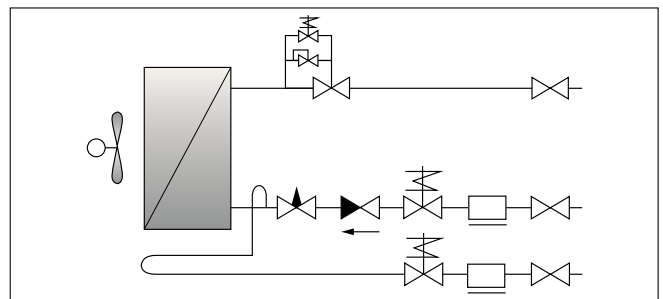


Figure 6: Commonly designed hot gas defrost system (not recommended)

for decelerated liquid, pressure spikes of up to 250 bar can occur, see figure 6.

In the correctly designed hot gas defrost system, the hot gas is introduced into the evaporator during defrost from the top, thus eliminating the risk of accelerated liquid at defrost initiation. The defrost pressure is controlled by a separate pressure control valve, enabling a purpose designed two-step solenoid valve with minimal pressure drop (usually hot gas powered) to be used in the wet return line. These valves are available on the market today (e.g. Danfoss ICLX). See figure 7.

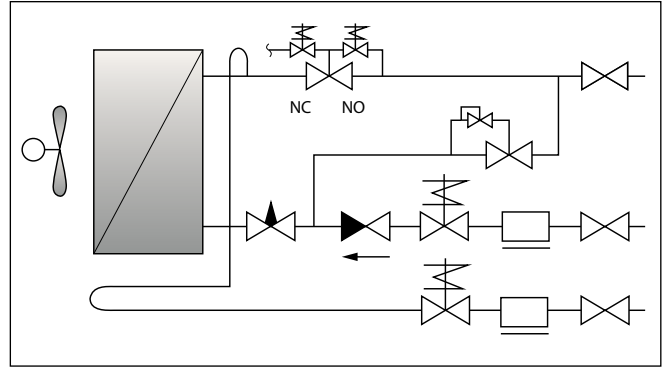


Figure 7: Moving liquid in pipe

In addition to the correct design of the system, it is also imperative to follow a safe and efficient hot gas defrost sequence. An example of such a sequence is shown in table 1.

Operation	Liquid	Wet return	Hot gas	Fan	Timer [s]	Comment
Cooling	Open	Open	Closed	On	N/A	Controlled by thermostat
Defrost start	Closed	Open	Closed	On	120 – 600	Pump down time depending on evaporator size
	Closed	Closing	Closed	Off	45 – 200	Closing time for hot gas powered suction valve - ICLX
	Closed	Closed	Closed	Off	10 – 20	Allowing remaining liquid to settle at bottom of evaporator
Defrost	Closed	Closed	Open	Off	1200 – 1800	Depends on application
Defrost stop	Closed	Closed	Closed	Off	60 – 180	Drip time
	Closed	Open	Closed	Off	90 – 300	Suction valve opens slowly. Static cooling to freeze droplets
	Open	Open	Closed	Off	60 – 90	Static cooling to freeze droplets
Cooling	Open	Open	Closed	On	N/A	Controlled by thermostat

Table 1: Safe and efficient hot gas defrost sequence

Examples of component failure

In the following, some examples of component damage are shown, some of which impose serious threat to the safety of operators or even members of the public.

Figure 8 shows typical damage to the casting of a solenoid valve, which was subject to VPLS due to condensed liquid in a hot gas line.



Figure 8: Bottom plate of damaged solenoid valve

Figure 9 shows a PM pilot operated servo valve, which was incorrectly installed in a wet return line as a shut-off valve, combined with a pressure relief function (see figure 6) and was subsequently subject to severe liquid hammer during defrost initiation.



Figure 9: PM valve, incorrectly installed in wet return line

4. Summary

In conclusion, it must be said that when introducing automatic controls for systems previously controlled by manual means, it is imperative to select the correct components for the purpose at hand, integrate these components in a safe way into properly designed industrial refrigeration systems and operate them in an efficient safe way to obtain optimum results.

3. Piping design and layout

ASME³ code for pressure piping stipulates that “consideration must be given to the expansion of liquid refrigerant trapped in or between closed valves and a means must be provided to prevent over pressure”.

Examples of such occurrences are shown in figure 10, e.g. liquid trapped between two shut-off valves, between a non-return valve and a solenoid valve or even between a non-return valve and a back pressure dependent regulator. In all these cases, suitable measure to prevent over pressure (such as relief valves) must be used.

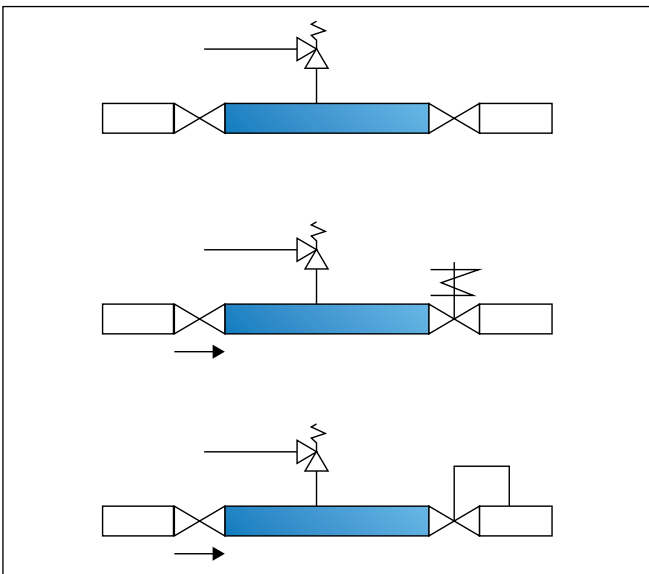


Figure 10: Examples of trapped liquid

³) ASME – American Society of Mechanical Engineers

We engineer **technologies** that
enable the world of tomorrow to
do more with less

80+ years

The industry's
widest expertise at
your disposal. We've
been looking ahead
since 1933

To read more about industrial refrigeration, please visit ir.danfoss.com
For questions, please contact your local Danfoss industrial refrigeration specialist.

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.